

Karnataka State Fire & Emergency Services Department

**DISTRICT FIRE OFFICE
Karnataka State Fire & Emergency Services
Takke Road, Vijayapur-586102**



**Office of the District Fire Officer
Karnataka State Fire & Emergency Services
VIJAYAPUR Fire Station , VIJAYAPUR-586101
Telephone:08352-270160**



C.NO.14/FSR/DFO/VIJAYAPUR/2026

Date- 13/01/2026

To,
The Principal
B.L.D.E.Association's Vijayapur
Sri.B.M.Patil Public School
BLDE New Campus,B.M.Patil Road
Bhutanal Village
Tq & Dist- Vijayapur

Sub : Issue of 'Fire Safety Recommendation' for "B.L.D.E.Association's Vijayapur" "Sri.B.M.Patil Public School", Situated at Sy.No.142/*/*, BLDE New Campus, B.M.Patil Road, Bhutanal Village, Tq & Dist- Vijayapur
Ref: 1.C NO:45/FSR/FSO/VIJAYAPUR/2026 Dt:- 08/01/2026

◇◇◇*@*◇◇◇

With reference to the subject above cited, the premises of "B.L.D.E.Association's Vijayapur" "Sri.B.M.Patil Public School", Situated at Sy.No.142/*/*, BLDE New Campus, B.M.Patil Road, Bhutanal Village, Tq & Dist- Vijayapur was inspected by The Fire Station Officer, Vijayapur on 05/01/2026 with respect to Fire prevention, Fire fighting and Evacuation measures to be complied in the above premises and the details as under.

ANNEXURE-1



(Up to 14.99 mtrs. In height)

"GROUP-B Educational Buildings

NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.
(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory.)

A. Details of the building / premises :-

01.	Name and Address of the Applicant.	:	The Principal B.L.D.E.Association's Vijayapur Sri.B.M.Patil Public School BLDE New Campus,B.M.Patil Road Bhutanal Village Tq & Dist- Vijayapur
02.	Name and Address of the premises.	:	Sri.B.M.Patil Public School", Situated at Sy.No.142/*/*, BLDE New Campus, B.M.Patil Road, Bhutanal Village, Tq & Dist- Vijayapur
03.	Name and address of the Building owner	:	The President B.L.D.E.Association's Vijayapur Sri.B.M.Patil Public School BLDE New Campus,B.M.Patil Road Bhutanal Village Tq & Dist- Vijayapur
04.	School Dis code	:	29031400426
05.	Number of buildings	:	01 Building.
06.	Number of floors	:	G+2 floors
<u>Floor wise details of occupancy:-</u>			
	Ground floor	:	Class Rooms-06 no's, Head Master Room-01, Activity Room-02, Art & Craft Room-01, Dance Room-

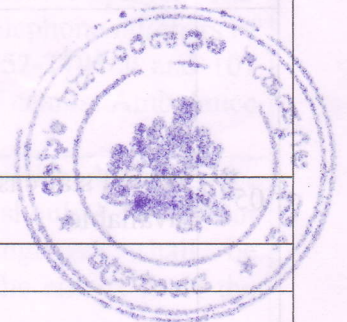
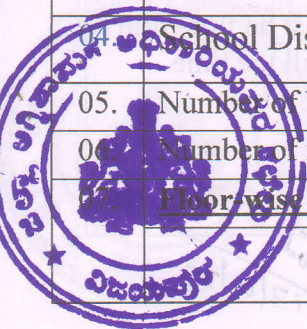


(B) 13/01/26

		01no,Musical Room-01no, Electrical Room-01no, Staff Room-01 , Waiting Space, Administrative Office Room-01no, Account Room-01no.
	1 st Floor	: Class Rooms-09 no's, Staff Room-01, Conference Room-01no,Waiting Lobby,Management Cabin,Activity Room-01no,Computer Lab-01no,Library
	2 nd floor	: Class Room's-08 no's, Composite Lab, Language Lab,Maths Lab.
08.	Height of the building	: 11.10 mtr
09.	Site area	: 33.17 Acre.
10.	Built-up area of each floor:-	
	Ground Floor	: 2179.64 Sq.mtr
	1 st Floor	: 1907.47 Sq.mtr
	2 nd Floor	: 1025.89 Sq.mtr
11.	Total built-up area	: 5113.00 Sq.mtr
12.	Surrounding properties:-	
	East	: Open Land
	West	: Open Land
	North	: Road 09.00 mtr
	South	: Open Land
13.	Set-back area available around the building :-	
	East	: 35.00 mtr
	West	: 10.00 mtr
	North	: 00.30 mtr
	South	: 10.00 mtr

B. On inspection of this Institutional premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)												
01.	Accessibility to the premises	The premises is accessible from 09.00 mtr wide road on the Northern side.	Adequate												
02.	No. of entrances	Provided 02 no's Of Entrance & 02 no's Of Exit.	-												
03.	Width of entry / exit	04.00 & 02.00 mtr each.	-												
04.	Diesel generators.	25 kva Capacity Diesel generator Provided	The generator has to be Provided & then connected to all lightings and emergency provisions in the building.												
05.	No. of staircases available	<table border="1"> <tr> <td>Nos. of staircases</td> <td>: 02 no's</td> </tr> <tr> <td>Width of staircases</td> <td>: 01.66 mtr Each</td> </tr> <tr> <td>Width of treads</td> <td>: 00.30 mtr Each</td> </tr> <tr> <td>Height of risers</td> <td>: 00.15 mtr Each</td> </tr> <tr> <td>Nos. of riser per flight</td> <td>: 12 No's Each</td> </tr> <tr> <td>Height of handrails</td> <td>: 01.20 mtr Each</td> </tr> </table>	Nos. of staircases	: 02 no's	Width of staircases	: 01.66 mtr Each	Width of treads	: 00.30 mtr Each	Height of risers	: 00.15 mtr Each	Nos. of riser per flight	: 12 No's Each	Height of handrails	: 01.20 mtr Each	The staircase must be free from Obstruction all the time.
Nos. of staircases	: 02 no's														
Width of staircases	: 01.66 mtr Each														
Width of treads	: 00.30 mtr Each														
Height of risers	: 00.15 mtr Each														
Nos. of riser per flight	: 12 No's Each														
Height of handrails	: 01.20 mtr Each														

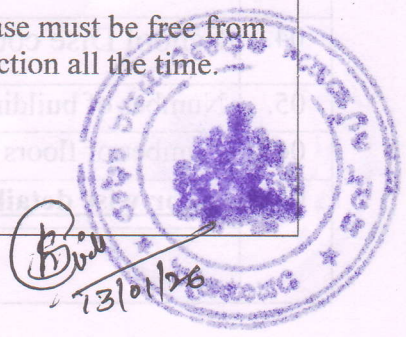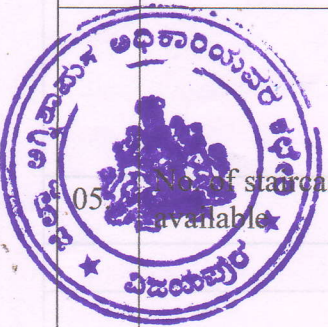

06.	Fire extinguisher	Provided 24 No's Of ABC Type Fire extinguishers Each 06.00 kgs Capacity	<p>A. One water mist extinguisher of 09 ltrs capacity should be kept near each staircase landing.</p> <p>B. One mechanical foam extinguisher of 09 ltr capacity & one ABC type extinguisher of 06 kgs capacity should be provided near the diesel generator.</p> <p>C. One CO2 type fire extinguisher of 4.5 kgs capacity should be provided near each electrical panel board & electrical room.</p> <p>D. One ABC type fire extinguisher of 06 Kgs capacity should be located as to be available within 15 mtrs. Radius.</p>
07.	Hose reel hose system	Not Provided	One Hose reel hose near the staircase (One hose reel hose system for every 1000 sq.mtrs) The hose reel hose of min 19 mm size and of 30 mtrs. length shall be provided to reach the farthest point of each floor and shut off branch having a nozzle of 05 mm size. The hose reel hose should be connected at each landing.
08.	Terrace Tank	Provided 05 no's of 1000 ltr capacity each, Terrace Tank.	<p>The system should be connected to an over head tank of 5000 ltrs capacity further if basement is provided the tank capacity shall be increased to 10,000 ltrs capacity. (The water tank should be kept exclusively for fire fighting purpose.)</p> <p>Note: if the existing building is not capable of sustaining the weight of 5,000/10,000 ltrs tank capacity provision shall be made to provide water tank on the side of the building with support from ground level by providing RCC column structure or MS column structure.</p> <p>If there is no option to provide even the above mentioned overhead tank provision shall be made to provide underground water tank of capacity with submersible pump of 5-7 HP capacity.</p>
09.	At the terrace tank level with minimum pressure of 3.5 kg/cm2	Not Provided.	<p>The system should be connected to an booster pump of 450 LPM or of 5 HP capacity.</p> <p>Further the system should be connected to an alternative source of power supply.</p>
10.	Escape routes	Not Marked	Escape route shall be marked with luminous light/paint at basement, ground and third floor directing towards exists and emergency exists .
11.	Fire order	Not provided.	Fire safety indicating the details of actions to be taken in case of emergency shall be displayed near each staircase landings with the telephone numbers of our Vijayapur Fire Station 08352-270160 and 101 numbers & telephone numbers of nearest Ambulance Service.
12.	No Smoking board	Not Displayed	COPTA Sec-4 direction of No Smoking area , smoking here is an offence board should be written in English & Kannada both languages shall be prominently displayed at inside the entry/exit of the each floor.
13.	Fire Siren	Not Installed	A Fire Siren shall be installed in the premises to inform the inmates in case of a fire emergency and evacuate the area.

DISTRICT FIRE OFFICER
VIJAYAPUR-586108



B
13/01/26

14.	Nominate One Fire Nodal Officer	--	A Fire Nodal Officer shall be nominated either from teaching or non teaching staff.
15.	Fire fighting training	No Trained persons.	At least 40% of employees shall be trained in basic fire fighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29.

16. Fire Precautionary Measures

- A :- Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory and electrical sum panel premises.
 Accumulation of combustible waste in and around the premises should be avoided.
 The exit ways shall be always kept clear without any obstruction.
 Liquefied petroleum gas should not be stored in the building.
 F:- The doors shall not be kept locked/ latched during working hours and shall be free from obstruction.
 F:- During the class hours the class room door shall not be locked from inside to out side.
 G:- As per Honorable Supreme Court order all teachers and staff shall be trained to handle safety equipments, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordination with the fire services department.

Under the above circumstance the Karnataka Fire & Emergency Services Department is issuing of 'Fire Safety Recommendation' "B.L.D.E.Association's Vijayapur" "Sri.B.M.Patil Public School", Situated at Sy.No.142/*/*, BLDE New Campus, B.M.Patil Road, Bhutanal Village, Tq & Dist- Vijayapur. subjected to condition and compliance of the above recommendations in column-4 of serial -B within 03 months and compliance to the undersigned.

This "**Fire Safety Recommendation**" is valid for only one year from the date of issue.

Yours Faithfully

B. J. J. 12/01/26
DISTRICT FIRE OFFICER
VIJAYAPUR-586108

